

CU2-15

Rectangular fire damper 120' at 1500 Pa



CE
0749



Table of content

| | |
|--|----|
| Declaration of performance | 3 |
| Product presentation CU2-15 | 4 |
| Range and dimensions CU2-15 | 4 |
| Variant CU2-15L | 5 |
| Range and dimensions CU2-15L | 5 |
| Evolution - kits | 6 |
| Options - at the time of order | 8 |
| Flange types - at the time of order | 9 |
| Storage and handling | 10 |
| Installation | 10 |
| Installation at a minimal distance from another damper or from an adjacent supporting construction | 10 |
| Installation in rigid wall | 11 |
| Operation and mechanisms | 12 |
| Electrical connection | 16 |
| Weights | 18 |
| Selection graphs | 20 |
| Example | 20 |
| Selection data | 21 |
| Sample order | 22 |
| Approvals and certificates | 22 |

Explanation of the abbreviations and pictograms

| | | |
|--|---|---|
| Wn = nominal width | E.TELE = power supply magnet | Sn = free air passage |
| Hn = nominal height | E.ALIM = power supply motor | ζ [-] = pressure loss coefficient |
| Dn = nominal diameter | V = volt | Q = air flow |
| E = integrity | W = watt | ΔP = static pressure drop |
| I = thermal insulation | Auto = automatic | v = air speed in the duct |
| S = smoke leakage | Tele = remote controlled | Lwa = A-weighted sound power level |
| Pa = pascal | Pnom = nominal capacity | Lw oct = sound power level per octave midband |
| ve = vertical wall penetration | Pmax = maximum capacity | dB(A) = A-weighted decibel value |
| ho = horizontal floor penetration | GKB (type A) / GKF (type F): "GKB" | ΔL = correction factor |
| o -> i = meets the criteria from the outside (o) to the inside (i) | stands for standard plasterboards (type A according to EN 520) while "GKF" | |
| i <-> o = fire side not important | plasterboards offer a higher fire resistance for a similar plate thickness (type F according to EN 520) | |
| V AC = Volt alternating current | Cal-Sil = calcium silicate | |
| V DC = Volt direct current | OP = option (delivered with the product) | |
| | KIT = kit (delivered separately for repair or upgrade) | |
| | PG = connection flange to the duct | |


| | | | |
|---|--|---|------------------------------------|
|  | fire resistance tested at a negative pressure of 1500 Pa |  | suitable for built-in installation |
|  | intermediate dimensions on request | | |

DECLARATION OF PERFORMANCE

CE_DoP_Rf-t_G7_EN ■ E-09/2018

| | | | |
|--|---|--|--|
| 1. Unique identification code of the product-type: | CU2-15 | | |
| 2. Intended use/s: | Rectangular fire damper to be used in conjunction with partitions to maintain fire compartments in heating, ventilating and air conditioning installations. | | |
| 3. Manufacturer: | Rf-Technologies NV, Lange Ambachtstraat 40, B-9860 Oosterzele | | |
| 4. System/s of AVCP: | System 1 | | |
| 5. Harmonised standard / European Assessment Document: notified body / European Technical Assessment, Technical Assessment Body, notified body, certificate of constancy of performance: | EN 15650:2010, BCCA with identification number 0749; BCCA-0749-CPR-BC1-606-0464; BCCA-0749-CPR-BC1-606-0464-15650:14-0464 | | |
| 6. Declared performance according to EN 15650:2010 | (Fire resistance according to EN 1366-2 and classifications according to EN 13501-3) | | |

| Essential characteristics | Performance | |
|---------------------------|--------------|---|
| | Installation | Classification |
| Range | 1 | EI 120 (v _e , i ↔ o) S - (1500 Pa) |

| | | | |
|---|---------------------------------------|---|--------------------------------------|
| 1 | Type of installation: built-in 0/180° |  | Harmonised standard EN 15650:2010 |
| Nominal activation conditions/sensitivity: | | | |
| Response delay (response time): closure time | | | |
| Operational reliability: cycling | | | |
| Durability of response delay: | | | |
| Durability of operational reliability: | | | |
| Protection against corrosion according to EN 60068-2-52: | | | |
| Damper casing leakage according to EN 1751: | | | |
| The performance of the product identified above is in conformity with the set of declared performance/s. This declaration of performance is issued, in accordance with Regulation (EU) No 305/2011, under the sole responsibility of the manufacturer identified above. | | | |

Signed for and on behalf of the manufacturer by:
Mathieu Steenland, Technical Manager

Mathieu Steenland

Oosterzele, 09/2018



Product presentation CU2-15

Rectangular fire damper with a 120 minutes fire resistance in concrete walls with air pressure up to 1500 Pascal. Its refractory casing is made of asbestos free panels, which are resistant to humidity.


Fire dampers are installed where air ducts penetrate fire-resistant compartment walls. Their role is to restore the fire resistance grade of the penetrated wall and to prevent smoke propagation. Fire dampers are distinguished by their degree of fire resistance, by their aerulic properties as well as by their installation ease. Rf-Technologies' fire dampers are all CE marked. They can be equipped with various types of mechanisms depending on the specific needs linked to the project or to the local regulations.

fire resistance tested at a negative pressure of 1500 Pa



- suitable for built-in installation
- air tightness in accordance with EN 1751: class B (class C in option)
- tested in accordance with EN1366-2 up to 1500 Pa
- operating mechanism outside the wall
- maintenance-free
- for indoor use
- operating temperature: max. 50°C
- intermediate dimensions on request
- suitable for installation in rigid wall


1. connection flange PG30
2. casing made of refractory material
3. damper blade
4. operating mechanism
5. sealing cold smoke
6. blade bumper
7. intumescent strip
8. transmission with locking (open/closed)
9. fusible link
10. product identification

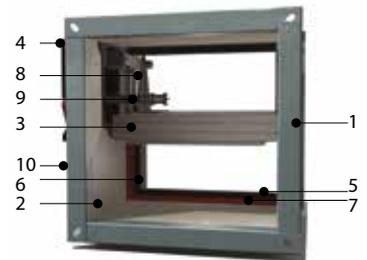

Range and dimensions CU2-15

Wn/Hn per step of 50 mm; intermediate dimensions are subject to extra cost (heights between ≥ 275 and ≤ 299 mm are not possible).

Exceeding blade: X = on the mechanism side, Y = on the wall side

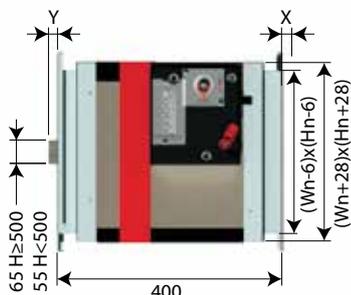

| Hn [mm] | 300 | 350 | 400 | 450 | 500 | 550 | 600 | 650 | 700 | 750 | 800 |
|---------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| x | - | - | - | - | - | - | 25 | 50 | 75 | 100 | 125 |
| y | 1 | 26 | 51 | 51 | 101 | 126 | 151 | 176 | 201 | 226 | 251 |

| | IV | V |
|--------------|---------|----------|
| (Wn x Hn) mm | 200x200 | 1200x800 |


Variant CU2-15L

Damper with a tunnel casing extension at one or both sides so that the damper blade does not exceed the tunnel. This version allows to connect a grill or a bend directly on the damper flange or to use a circular connection.

Range and dimensions CU2-15L

Wn/Hn per step of 50 mm; intermediate dimensions are subject to extra cost (heights between ≥ 275 and ≤ 299 mm are not possible).



Exceeding blade: X = on the mechanism side, Y = on the wall side

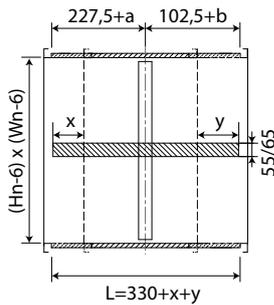

| | IV | V |
|-----------------|---------|----------|
| (Wn x Hn) mm | 200x200 | 1200x800 |

Hn < 300 mm

Hn ≥ 300 mm

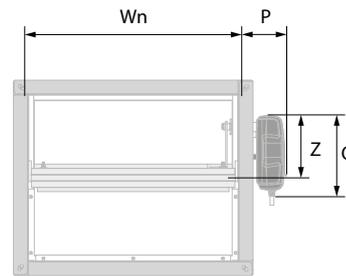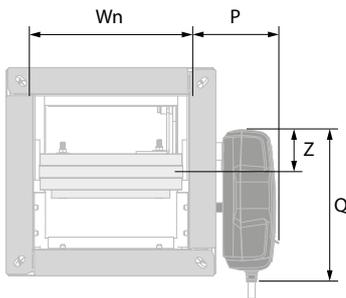

| | CFTH | ONE | BFL(T) |
|----------|------|-----|--------|
| P | 78 | 104 | 96 |
| Q | 180 | 191 | 110 |
| Z | 62 | 47 | 74 |

| | CFTH | ONE | BFL(T) | BFN(T) |
|----------|------|-----|--------|--------|
| P | 78 | 104 | 96 | 100 |
| Q | 180 | 191 | 110 | 110 |
| Z | 157 | 147 | 180 | 180 |

Evolution - kits

| | | |
|---|-----------------------|--|
|  | KITS CFTH | Automatic unlocking mechanism CFTH with FCU and without FTH 72 |
|  | KITS BFL24 | Spring return actuator BFL 24V |
|  | KITS BFL24-ST | Spring return actuator BFL 24V with plug (ST) |
|  | KITS BFLT24 | Spring return actuator BFL 24V with thermo-electric fuse (T) |
|  | KITS BFLT24-ST | Spring return actuator BFL 24V with thermo-electric fuse (T) and plug (ST) |
|  | KITS BFL230 | Spring return actuator BFL 230V |
|  | KITS BFLT230 | Spring return actuator BFL 230V with thermo-electric fuse (T) |
|  | KITS BFN24 | Spring return actuator BFN 24V (BFN kits must be used instead of BFL kits for fire dampers produced before 1/7/2015) |
|  | KITS BFN24 | Spring return actuator BFN 24V |

| | | |
|---|----------------------------|--|
|  | KITS BFN24-ST | Spring return actuator BFN 24V with plug (ST) |
|  | KITS BFN24 | Spring return actuator BFN 24V with thermo-electric fuse (T) |
|  | KITS BFN24-ST | Spring return actuator BFN 24V with thermo-electric fuse (T) and plug (ST) |
|  | KITS BFN230 | Spring return actuator BFN 230V |
|  | KITS BFN230 | Spring return actuator BFN 230V with thermo-electric fuse (T) |
|  | KITS BF24 | Spring return actuator BF 24V (BF kits must be used instead of BFN kits for fire dampers produced before 1/7/2015) |
|  | KITS ONE T 24 FDCU | Spring return actuator ONE 24V (with fusible link T) + unipolar beginning- and end-of-range switch |
|  | KITS ONE T 24 FDCB | Spring return actuator ONE 24V (with fusible link T) + bipolar beginning- and end-of-range switch |
|  | KITS ONE T 230 FDCU | Spring return actuator ONE 230V (with fusible link T) + unipolar beginning- and end-of-range switch |

| | | |
|---|----------------------------|--|
|  | KITS ONE T 230 FDCB | Spring return actuator ONE 230V (with fusible link T) + bipolar beginning- and end-of-range switch |
|  | KITS FDC CFTH | 1 limit switch (FCU/DCU/FCB/DCB) |
|  | KITS SN2 BFL/BFN | Auxiliary limit switch 'open/closed' |
|  | KITS FTH72 | Fusible link FTH 72°C (for CFTH) |
|  | KITS ZBAT 72 | Black spare part for thermo-electric fuse for BFLT/BFNT |
|  | FUS72 ONE | Fusible link 72°C |
|  | MECT | Testbox for mechanisms 24/48 V (magnet, motor, beginning and end of range switches) |


Options - at the time of order



EN1751_C


Air-tightness class C

Flange types - at the time of order

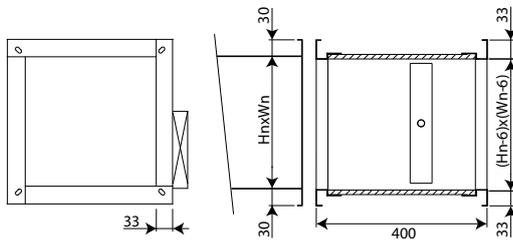


PG30

Connection to ducts with 30 mm flanges (either by sliding profile, or with bolts, or with clamps). Elliptical holes $\varnothing 8,5 \times 16$ mm.

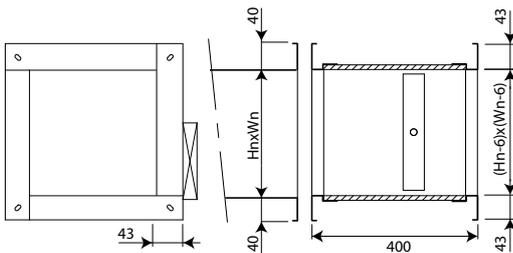


PG40

Connection to ducts with 40 mm flanges. Elliptical holes $\varnothing 8,5 \times 16$ mm.

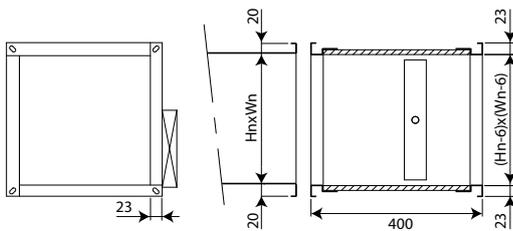


PG20

Connection to ducts with 20 mm flanges. Elliptical holes $\varnothing 6,5 \times 16$ mm.




PM

Connection to ducts by insertion. This type of frame is used in case of lack of space for a standard PG30 frame.




PP

No connection. This type of frame is used on one side of a damper that ends into a room.



PRJ

Circular connection with rubber sealing ring.



PPT

Grill. Very well suited as protection grill on the end piece of a duct system.

Storage and handling

As this product is a safety element, it should be stored and handled with care.

Avoid:

- any kind of impact or damage
- contact with water
- deformation of the casing

It is recommended:


- to unload in a dry area
- not to flip or roll the product to move it
- not to use the damper as a scaffold, working table, etc.
- not to store smaller dampers inside larger ones

Installation

General points


- The installation must comply with the installation manual delivered with the product and the classification report.
- Axis orientation: see the declaration of performance.
- Avoid obstruction of adjoining ducts.
- Product installation: always with closed damper blade.
- Verify if the blade can move freely.
- Please observe safety distances with respect to other construction elements. The operating mechanism must also remain accessible: allow for a clearance of 200 mm around the housing.
- The air tightness class will be maintained if the damper is installed according to the installation manual.
- Rf-t fire dampers are always tested in standardised constructions according to EN 1366-2. The achieved results are valid for similar supporting constructions with a fire resistance, thickness and density equal or superior to the supporting construction used during the test.
- The damper must remain accessible for inspection and maintenance.
- Schedule at least two running visual checks each year.

| | TEST | |
|------|-------------------------------------|-------------------------------------|
| 2017 | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> |
| 2018 | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> |
| 2019 | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 2020 | <input type="checkbox"/> | <input type="checkbox"/> |
| 2021 | <input type="checkbox"/> | <input type="checkbox"/> |



Installation at a minimal distance from another damper or from an adjacent supporting construction

1

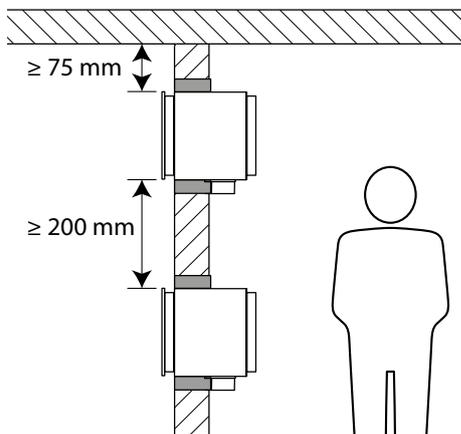

1. Principle


According to the European test standard, a fire damper must be installed at a minimum distance of 75 mm from an adjacent wall and 200 mm from another damper, unless the solution was tested at a shorter distance.

Installation in rigid wall


The product was tested and approved in:

| Range | Wall type | Sealing | Classification |
|--|------------|---|---|
| $200 \times 200 \text{ mm} \leq \text{CU2-15} \leq 1200 \times 800 \text{ mm}$ | Rigid wall | Reinforced concrete $\geq 110 \text{ mm}$ | EI 120 (v_e i \leftrightarrow o) S - (1500 Pa) |


1

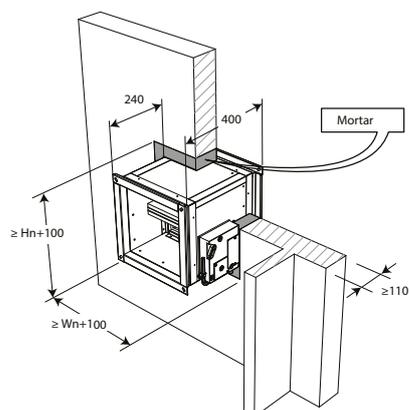

2

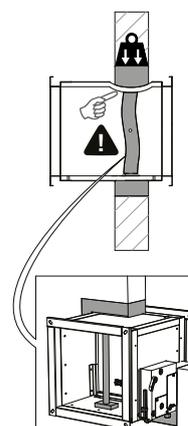

3



Maintenance

- No specific maintenance required.
- Schedule at least two running visual checks each year.
- Remove dust and all other particles before start-up.
- Follow the local maintenance regulations (i.e. BS9999 Annex V; NF S 61-933) and EN13306.
- Read the maintenance instructions on our website: https://www.rft.be/assets//PIM/DOCUMENTS/BROCHURE%20KITS/BRO_K139_MAINTENANCE_C.pdf
- Use the damper at up to 95% humidity, non-condensing.
- The fire damper can be cleaned with a dry or slightly damp cloth. It is forbidden to use abrasive cleaners or mechanical cleaning techniques (brush).


Operation and mechanisms



CFTH Mechanism with fusible link

The unlocking mechanism CFTH automatically unlatches the damper blade when the temperature in the duct rises above 72°C. The damper can also be unlocked and reset manually.

1. unlocking button
2. resetting handle
3. cable entrance



Options - at the time of order

| | |
|------|--|
| FCU | Limit switch 'closed' |
| FDCU | Unipolar limit switch 'open/closed' |
| FDCB | Bipolar auxiliary limit switch 'open/closed' |

Unlocking

- **manual unlocking:** use the unlocking button (1).
- **automatic unlocking:** when the fusible link melts at 72° C.
- **remote unlocking:** n/a

Resetting

- **manual resetting:** use the enclosed Hex key and turn clockwise(2).
- **motorised resetting:** n/a

Caution:


- ⚠ The mechanism may never be tested on its own, without being attached to the damper. Such a test might damage the mechanism or the operator might be injured.



ONE Spring return actuator for remote control

The spring-return actuator ONE is designed to easily operate Rf-t fire dampers of all sizes, automatically or remotely. Five models are available, 24 or 230 volt, with FDCU or FDCB position switches; and 24 volt with plug (ST).

1. unlocking button
2. blade position indicator
3. LED
4. battery compartment to reset motor
5. plug (ST)



Options - at the time of order

| | |
|------------|---|
| IXI-R1 | Universal field controller (Modbus, BACnet or analog connection), pre-mounted on the damper. |
| IXI-R2-24 | Universal field controller (Modbus, BACnet), pre-mounted on the damper and with a connection for a second damper. |
| IXI-R2-230 | Universal field controller (Modbus, BACnet), pre-mounted on the damper and with a connection for a second damper. |

Unlocking

- **manual unlocking:** shortly press the unlocking button (1) once.
- **automatic unlocking:** the fusible link reacts as soon as the temperature in the duct reaches 72°C.
- **remote unlocking:** by interrupting the power supply.

Resetting

- **manual resetting:** open the battery compartment (4) and press a 9V battery against the contact springs. Hold this position until the LED (3) emits a continuous light. Check whether the indicator (2) shows that the damper blade is in the open position. Remove the battery, the LED fades away. Close the battery compartment.
- **motorised resetting:** switch off the power supply for at least 5 sec. Power the actuator (respect the prescribed voltage) for at least 75 sec. The resetting stops automatically when the end of range is reached (damper open).

Caution:

- ⚠ If the LED (3) flickers fast (3x/sec.), the battery is discharged: use a new battery.
- ⚠ If the LED (3) flickers slowly (1x/sec), the resetting is in progress.
- ⚠ If the LED (3) is continuously on, the resetting is complete and the motor is powered.
- ⚠ If the actuator detects voltage on the power cable, a brief contact of the battery is enough to start the resetting process.
- ⚠ The power supply of this actuator cannot be individually replaced. If the cable is damaged, the whole unit must be discarded and replaced.
- ⚠ The housing of the mechanism contains a temperature sensor. When the temperature in the housing exceeds 72°C, the mechanism unlocks. The LED flashes twice per second. When the temperature drops below 72°C, the mechanism can only be reset in a motorised manner after a manual reset (with a battery).
- ⚠ The end of range switches need 1 second after operation to adopt a stable position.
- ⚠ Make sure the thermal trigger device is present in the actuator. The actuator might not function properly if this is not the case.


| | prod. < 1/7/2015 | | | | prod. ≥ 1/7/2015 | | | |
|---------|-------------------|-------------------|---------------------|---------------------|-----------------------|-------------------|---------------------|---------------------|
| | CR60(1s) CR120 | CU-LT CU-LT-1s | CR2≤400 CU2≤1200 | CR2>400 CU2>1200 | CR60(1s) CR120(1s) | CU-LT CU-LT-1s | CR2≤400 CU2≤1200 | CR2>400 CU2>1200 |
| Kit ONE | ● | ● | ● | | ● | ● | ● | ● |



BFL(T) Remotely controlled spring return actuator

The spring return actuator BFL(T) is specially designed to remotely control fire dampers. The BFL(T) model is intended for fire dampers with smaller dimensions ($\varnothing \leq 400$ mm or $W+H \leq 1200$ mm/1400 mm for CU-LT, CU-LT-1s).

1. locking button
2. plug (ST)
3. access for manual resetting
4. thermo-electric tripping device (T)



Options - at the time of order

| | |
|-------------|---|
| SN2 BFL/BFN | Auxiliary limit switch 'open/closed' |
| IXI-R1 | Universal field controller (Modbus, BACnet or analog connection), pre-mounted on the damper. |
| IXI-R2-24 | Universal field controller (Modbus, BACnet), pre-mounted on the damper and with a connection for a second damper. |
| IXI-R2-230 | Universal field controller (Modbus, BACnet), pre-mounted on the damper and with a connection for a second damper. |

Unlocking

- **manual unlocking:** place the locking button on "unlock". (In case of BFLT: the damper can alternatively be unlocked by pushing the "test" button on the thermo-electric fuse)
- **automatic unlocking:** the thermo-electric fuse reacts as soon as the temperature reaches 72°C (type BFLT).
- **remote unlocking:** by interrupting the power supply.

Caution:

- ⚠ The thermo-electric fuse will not move the damper into its safety position (when the temperature reaches 72°C) if the motor is not powered.

Resetting

- **manual resetting:** turn the enclosed handle anti-clockwise. To block the motor, place the locking button on "lock"
- **motorised resetting:** switch off the power supply for at least 10 seconds. Supply the actuator (respect the prescribed voltage) for at least 75 seconds. The resetting stops automatically when the end of range is reached (damper open) - it takes about 60 seconds to reset the damper - or when the power supply is interrupted.

Caution:

- ⚠ Do not use a drill or screwing machine.
- ⚠ Stop as soon as the motor is completely rearmed (end of range).


| | prod. < 1/7/2015 | | | | prod. ≥ 1/7/2015 | | | |
|---------|-------------------|-------------------|---------------------|---------------------|------------------------|-------------------|---------------------|---------------------|
| | CR60(1s) CR120 | CU-LT CU-LT-1s | CR2≤400 CU2≤1200 | CR2>400 CU2>1200 | CR60(1s) CR120 (1s) | CU-LT CU-LT-1s | CR2≤400 CU2≤1200 | CR2>400 CU2>1200 |
| Kit BFL | | | | | ● | ● | ● | |
| Kit BFN | ● | ● | ● | | | | | ● |
| Kit BF | | | | ● | | | | |



BFN(T) Remotely controlled spring return actuator

The spring return actuator BFN(T) is specially designed to remotely control fire dampers. The BFN(T) model is intended for fire dampers with large dimensions ($\varnothing > 400$ mm (CR2) or W+H > 1200 mm (CU2, CA2, CU2-15, CU4)) or for dampers CU-LT(-1s), CR60, CR120 with a production date before 1 July 2015.

1. locking button
2. plug (ST)
3. access for manual resetting
4. thermo-electric tripping device (T)



Options - at the time of order

| | |
|-------------|---|
| SN2 BFL/BFN | Auxiliary limit switch 'open/closed' |
| IXI-R1 | Universal field controller (Modbus, BACnet or analog connection), pre-mounted on the damper. |
| IXI-R2-24 | Universal field controller (Modbus, BACnet), pre-mounted on the damper and with a connection for a second damper. |
| IXI-R2-230 | Universal field controller (Modbus, BACnet), pre-mounted on the damper and with a connection for a second damper. |

Unlocking

- **manual unlocking:** place the locking button on “unlock”. (In case of BFNT: the damper can alternatively be unlocked by pushing the “test” button on the thermo-electric fuse)
- **automatic unlocking:** the thermo-electric fuse reacts as soon as the temperature reaches 72°C (type BFNT).
- **remote unlocking:** by interrupting the power supply.

Caution:

- ▲ The thermo-electric fuse will not move the damper into its safety position (when the temperature reaches 72°C) if the motor is not powered.

Resetting

- **manual resetting:** turn the enclosed handle anti-clockwise. To block the motor, place the locking button on “lock”
- **motorised resetting:** switch off the power supply for at least 10 seconds. Supply the actuator (respect the prescribed voltage) for at least 75 seconds. The resetting stops automatically when the end of range is reached (damper open) - it takes about 60 seconds to reset the damper - or when the power supply is interrupted.

Caution:


- ▲ Do not use a drill or screwing machine.
- ▲ Stop as soon as the motor is completely rearmed (end of range).

Caution:


- ▲ The mechanism may never be tested on its own, without being attached to the damper. Such a test might damage the mechanism or the operator might be injured.

| | prod. < 1/7/2015 | | | | prod. ≥ 1/7/2015 | | | |
|---------|-------------------|-------------------|---------------------|---------------------|------------------------|-------------------|---------------------|---------------------|
| | CR60(1s) CR120 | CU-LT CU-LT-1s | CR2≤400 CU2≤1200 | CR2>400 CU2>1200 | CR60(1s) CR120 (1s) | CU-LT CU-LT-1s | CR2≤400 CU2≤1200 | CR2>400 CU2>1200 |
| Kit BFL | | | | | ● | ● | ● | |
| Kit BFN | ● | ● | ● | | | | | ● |
| Kit BF | | | | ● | | | | |

Electrical connection

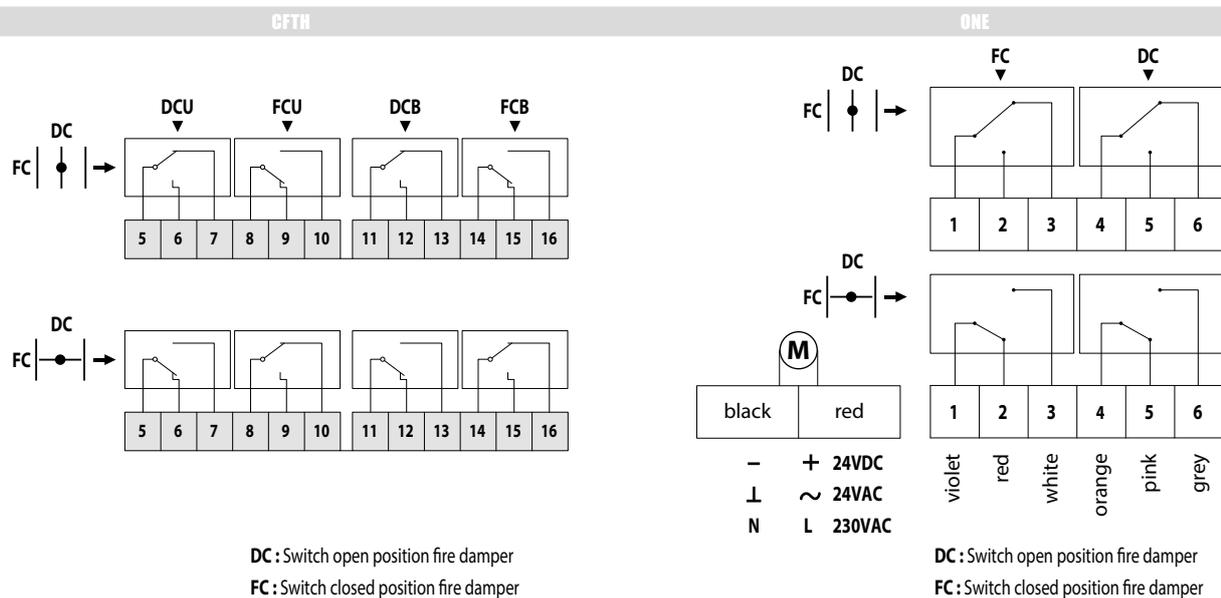

| MEC | Nominal voltage motor | Nominal voltage magnet | Power consumption (stand-by) | Power consumption (operating) | Standard switches |
|-----------------|-----------------------|------------------------|------------------------------|-------------------------------|---------------------------|
| CFTH | N/A | N/A | N/A | N/A | 1mA...6A, DC 5V...AC 250V |
| ONET 24 FDCU | 24 V AC/DC (-10/+20%) | N/A | 0,28W | 4,2W | 1mA...1A 60V |
| ONET 24 FDCB | 24 V AC/DC (-10/+20%) | N/A | 0,28W | 4,2W | 1mA...1A 60V |
| ONET 230 FDCU | 230 V AC (-15/+15%) | N/A | 0,57W | 4,2W | 1mA...1A 60V |
| ONET 230 FDCB | 230 V AC (-15/+15%) | N/A | 0,57W | 4,2W | 1mA...1A 60V |
| ONET 24 FDCU ST | 24 V AC/DC (-10/+20%) | N/A | 0,28W | 4,2W | 1mA...1A 60V |
| BFL24 | 24 V AC/DC | N/A | 0,7W | 2,5W | 1mA...3A, AC 250V |
| BFL24-ST | 24 V AC/DC | N/A | 0,7W | 2,5W | 1mA...3A, AC 250V |
| BFLT24 | 24 V AC/DC | N/A | 0,8W | 2,5W | 1mA...3A, AC 250V |
| BFLT24-ST | 24 V AC/DC | N/A | 0,8W | 2,5W | 1mA...3A, AC 250V |
| BFL230 | 230 V AC | N/A | 1,1W | 3,5W | 1mA...3A, AC 250V |
| BFLT230 | 230 V AC | N/A | 1,4W | 4W | 1mA...3A, AC 250V |
| BFN24 | 24 V AC/DC | N/A | 1W | 4W | 1mA...3A, AC 250V |
| BFN24-ST | 24 V AC/DC | N/A | 1W | 4W | 1mA...3A, AC 250V |
| BFNT24 | 24 V AC/DC | N/A | 1,1W | 4W | 1mA...3A, AC 250V |
| BFNT24-ST | 24 V AC/DC | N/A | 1,1W | 4W | 1mA...3A, AC 250V |
| BFN230 | 230 V AC | N/A | 1,5W | 5W | 1mA...3A, AC 250V |
| BFNT230 | 230 V AC | N/A | 1,8W | 5,5W | 1mA...3A, AC 250V |

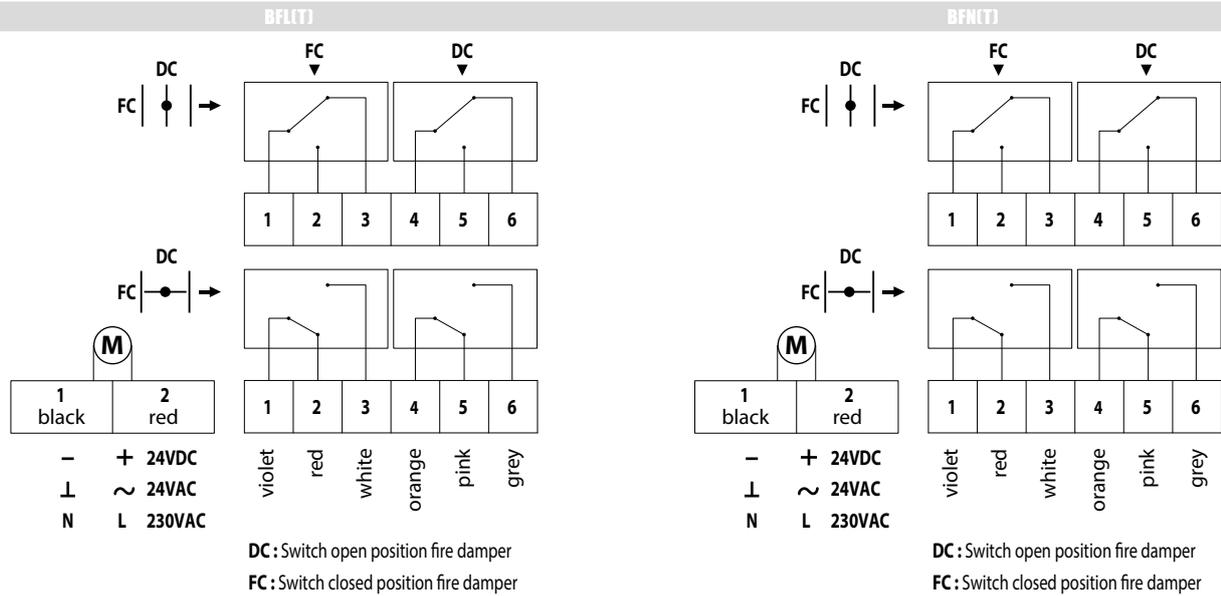

| Resetting time motor | Running time spring | Noise level motor | Noise level spring | Cable supply / control | Cable auxiliary switch | Protection class |
|------------------------------------|---------------------|-------------------|--------------------|--|--|------------------|
| N/A | 1 s | N/A | N/A | | | IP 42 |
| < 75 s (cabled) / < 85 s (battery) | < 30 s | < 58 dB (A) | < 60 dB (A) | 1 m, 2 x 0.75 mm ² | 1 m, 6 x 0.75 mm ² | IP 54 |
| < 75 s (cabled) / < 85 s (battery) | < 30 s | < 58 dB (A) | < 60 dB (A) | 1 m, 2 x 0.75 mm ² | (2x) 1 m, 6 x 0.75 mm ² | IP 54 |
| < 75 s (cabled) / < 85 s (battery) | < 30 s | < 58 dB (A) | < 60 dB (A) | 1 m, 2 x 0.75 mm ² | 1 m, 6 x 0.75 mm ² | IP 54 |
| < 75 s (cabled) / < 85 s (battery) | < 30 s | < 58 dB (A) | < 60 dB (A) | 1 m, 2 x 0.75 mm ² | (2x) 1 m, 6 x 0.75 mm ² | IP 54 |
| < 75 s (cabled) / < 85 s (battery) | < 30 s | < 58 dB (A) | < 60 dB (A) | 1 m, 2 x 0.75 mm ² | 1 m, 6 x 0.75 mm ² | IP 54 |
| < 60 s | 20 s | < 43 dB (A) | < 62 dB (A) | 1 m, 2 x 0.34 mm ² (halogen-free) | 1 m, 6 x 0.75 mm ² (halogen-free) | IP 54 |
| < 60 s | 20 s | < 43 dB (A) | < 62 dB (A) | 1 m, 2 x 0.75 mm ² (halogen-free) | 1 m, 6 x 0.75 mm ² (halogen-free) | IP 54 |
| < 60 s | 20 s | < 43 dB (A) | < 62 dB (A) | 1 m, 2 x 0.34 mm ² (halogen-free) | 1 m, 6 x 0.75 mm ² (halogen-free) | IP 54 |
| < 60 s | 20 s | < 43 dB (A) | < 62 dB (A) | 1 m, 2 x 0.75 mm ² (halogen-free) | 1 m, 6 x 0.75 mm ² (halogen-free) | IP 54 |
| < 60 s | 20 s | < 43 dB (A) | < 62 dB (A) | 1 m, 2 x 0.75 mm ² (halogen-free) | 1 m, 6 x 0.75 mm ² (halogen-free) | IP 54 |
| < 60 s | 20 s | < 43 dB (A) | < 62 dB (A) | 1 m, 2 x 0.75 mm ² (halogen-free) | 1 m, 6 x 0.75 mm ² (halogen-free) | IP 54 |
| < 60 s | 20 s | ≤ 55 dB (A) | ca. 70 dB (A) | 1 m, 2 x 0.34 mm ² (halogen-free) | 1 m, 6 x 0.75 mm ² (halogen-free) | IP 54 |
| < 60 s | 20 s | ≤ 55 dB (A) | ca. 70 dB (A) | 1 m, 2 x 0.75 mm ² (halogen-free) | 1 m, 6 x 0.75 mm ² (halogen-free) | IP 54 |
| < 60 s | 20 s | ≤ 55 dB (A) | ca. 70 dB (A) | 1 m, 2 x 0.34 mm ² (halogen-free) | 1 m, 6 x 0.75 mm ² (halogen-free) | IP 54 |
| < 60 s | 20 s | ≤ 55 dB (A) | ca. 70 dB (A) | 1 m, 2 x 0.75 mm ² (halogen-free) | 1 m, 6 x 0.75 mm ² (halogen-free) | IP 54 |
| < 60 s | 20 s | ≤ 55 dB (A) | ca. 70 dB (A) | 1 m, 2 x 0.75 mm ² (halogen-free) | 1 m, 6 x 0.75 mm ² (halogen-free) | IP 54 |
| < 60 s | 20 s | ≤ 55 dB (A) | ca. 70 dB (A) | 1 m, 2 x 0.75 mm ² (halogen-free) | 1 m, 6 x 0.75 mm ² (halogen-free) | IP 54 |

CU2-15 + BFLT

| Hn\Wn (mm) | | 200 | 250 | 300 | 350 | 400 | 450 | 500 | 550 | 600 | 650 | 700 | 750 | 800 | 850 | 900 | 950 | 1000 | 1050 | 1100 | 1150 | 1200 |
|------------|----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 200 | kg | 11,2 | 12,5 | 13,7 | 14,9 | 16,1 | 17,4 | 18,6 | 19,8 | 21,0 | 22,3 | 23,5 | 24,7 | 25,9 | 27,1 | 28,4 | 29,6 | 30,8 | - | - | - | - |
| 250 | kg | 12,5 | 13,8 | 15,2 | 16,5 | 17,8 | 19,2 | 20,5 | 21,9 | 23,2 | 24,5 | 25,9 | 27,2 | 28,6 | 29,9 | 31,3 | 32,6 | - | - | - | - | - |
| 300 | kg | 13,7 | 15,2 | 16,6 | 18,1 | 19,5 | 21,0 | 22,5 | 23,9 | 25,4 | 26,8 | 28,3 | 29,8 | 31,2 | 32,7 | 34,2 | - | - | - | - | - | - |
| 350 | kg | 14,9 | 16,5 | 18,1 | 19,7 | 21,2 | 22,8 | 24,4 | 26,0 | 27,6 | 29,1 | 30,7 | 32,3 | 33,9 | 35,5 | - | - | - | - | - | - | - |
| 400 | kg | 16,1 | 17,8 | 19,5 | 21,2 | 22,9 | 24,6 | 26,3 | 28,0 | 29,7 | 31,4 | 33,1 | 34,8 | 36,6 | - | - | - | - | - | - | - | - |
| 450 | kg | 17,4 | 19,2 | 21,0 | 22,8 | 24,6 | 26,5 | 28,3 | 30,1 | 31,9 | 33,7 | 35,6 | 37,4 | - | - | - | - | - | - | - | - | - |
| 500 | kg | 18,6 | 20,5 | 22,5 | 24,4 | 26,3 | 28,3 | 30,2 | 32,2 | 34,1 | 36,0 | 38,0 | - | - | - | - | - | - | - | - | - | - |
| 550 | kg | 19,8 | 21,9 | 23,9 | 26,0 | 28,0 | 30,1 | 32,2 | 34,2 | 36,3 | 38,3 | - | - | - | - | - | - | - | - | - | - | - |
| 600 | kg | 21,0 | 23,2 | 25,4 | 27,6 | 29,7 | 31,9 | 34,1 | 36,3 | 38,5 | - | - | - | - | - | - | - | - | - | - | - | - |
| 650 | kg | 22,3 | 24,5 | 26,8 | 29,1 | 31,4 | 33,7 | 36,0 | 38,3 | - | - | - | - | - | - | - | - | - | - | - | - | - |
| 700 | kg | 23,5 | 25,9 | 28,3 | 30,7 | 33,1 | 35,6 | 38,0 | - | - | - | - | - | - | - | - | - | - | - | - | - | - |
| 750 | kg | 24,7 | 27,2 | 29,8 | 32,3 | 34,8 | 37,4 | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - |
| 800 | kg | 25,9 | 28,6 | 31,2 | 33,9 | 36,6 | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - |


CU2-15 + BFN

| Hn\Wn (mm) | | 200 | 250 | 300 | 350 | 400 | 450 | 500 | 550 | 600 | 650 | 700 | 750 | 800 | 850 | 900 | 950 | 1000 | 1050 | 1100 | 1150 | 1200 |
|------------|----|-----|-----|-----|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 200 | kg | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | 32,2 | 33,5 | 34,7 | 35,9 |
| 250 | kg | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | 34,1 | 35,5 | 36,8 | 38,2 | 39,5 |
| 300 | kg | - | - | - | - | - | - | - | - | - | - | - | - | - | - | 35,8 | 37,3 | 38,7 | 40,2 | 41,7 | 43,1 | 44,6 |
| 350 | kg | - | - | - | - | - | - | - | - | - | - | - | - | - | 37,3 | 38,8 | 40,4 | 42,0 | 43,6 | 45,2 | 46,7 | 48,3 |
| 400 | kg | - | - | - | - | - | - | - | - | - | - | - | - | 38,5 | 40,2 | 41,9 | 43,6 | 45,3 | 47,0 | 48,7 | 50,4 | 52,1 |
| 450 | kg | - | - | - | - | - | - | - | - | - | - | - | 39,4 | 41,2 | 43,1 | 44,9 | 46,7 | 48,5 | 50,3 | 52,2 | 54,0 | 55,8 |
| 500 | kg | - | - | - | - | - | - | - | - | - | - | 40,1 | 42,1 | 44,0 | 45,9 | 47,9 | 49,8 | 51,8 | 53,7 | 55,6 | 57,6 | 59,5 |
| 550 | kg | - | - | - | - | - | - | - | - | - | 40,6 | 42,7 | 44,7 | 46,8 | 48,8 | 50,9 | 53,0 | 55,0 | 57,1 | 59,1 | 61,2 | 63,3 |
| 600 | kg | - | - | - | - | - | - | - | - | 40,8 | 43,0 | 45,2 | 47,4 | 49,6 | 51,7 | 53,9 | 56,1 | 58,3 | 60,5 | 62,6 | 64,8 | 66,9 |
| 650 | kg | - | - | - | - | - | - | - | - | 40,8 | 43,1 | 45,4 | 47,7 | 50,0 | 52,3 | 54,6 | 56,9 | 59,2 | 61,5 | 63,8 | 66,1 | 68,4 |
| 700 | kg | - | - | - | - | - | - | 40,6 | 43,0 | 45,4 | 47,9 | 50,3 | 52,7 | 55,1 | 57,5 | 60,0 | 62,4 | 64,8 | 67,2 | 69,6 | 72,1 | 74,5 |
| 750 | kg | - | - | - | - | - | 40,1 | 42,7 | 45,2 | 47,7 | 50,3 | 52,8 | 55,4 | 57,9 | 60,4 | 63,0 | 65,5 | 68,1 | 70,6 | 73,1 | 75,7 | 78,2 |
| 800 | kg | - | - | - | - | 39,4 | 42,1 | 44,7 | 47,4 | 50,0 | 52,7 | 55,4 | 58,0 | 60,7 | 63,3 | 66,0 | 68,6 | 71,3 | 74,0 | 76,6 | 79,3 | 81,9 |

CU2-15 + BFNT

| Hn\Wn (mm) | | 200 | 250 | 300 | 350 | 400 | 450 | 500 | 550 | 600 | 650 | 700 | 750 | 800 | 850 | 900 | 950 | 1000 | 1050 | 1100 | 1150 | 1200 |
|------------|----|-----|-----|-----|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 200 | kg | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | 32,3 | 33,6 | 34,8 | 36,0 |
| 250 | kg | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | 34,2 | 35,6 | 36,9 | 38,3 | 39,6 |
| 300 | kg | - | - | - | - | - | - | - | - | - | - | - | - | - | - | 35,9 | 37,4 | 38,8 | 40,3 | 41,8 | 43,2 | 44,7 |
| 350 | kg | - | - | - | - | - | - | - | - | - | - | - | - | - | 37,4 | 38,9 | 40,5 | 42,1 | 43,7 | 45,3 | 46,8 | 48,4 |
| 400 | kg | - | - | - | - | - | - | - | - | - | - | - | - | 38,6 | 40,3 | 42,0 | 43,7 | 45,4 | 47,1 | 48,8 | 50,5 | 52,2 |
| 450 | kg | - | - | - | - | - | - | - | - | - | - | - | 39,5 | 41,3 | 43,2 | 45,0 | 46,8 | 48,6 | 50,4 | 52,3 | 54,1 | 56,0 |
| 500 | kg | - | - | - | - | - | - | - | - | - | - | 40,2 | 42,2 | 44,1 | 46,0 | 48,0 | 49,9 | 51,9 | 53,8 | 55,7 | 57,7 | 59,6 |
| 550 | kg | - | - | - | - | - | - | - | - | - | 40,7 | 42,8 | 44,8 | 46,9 | 48,9 | 51,0 | 53,1 | 55,1 | 57,2 | 59,2 | 61,3 | 63,3 |
| 600 | kg | - | - | - | - | - | - | - | - | 40,9 | 43,1 | 45,3 | 47,5 | 49,7 | 51,8 | 54,0 | 56,2 | 58,4 | 60,6 | 62,7 | 64,9 | 67,0 |
| 650 | kg | - | - | - | - | - | - | - | 40,9 | 43,2 | 45,5 | 47,8 | 50,1 | 52,4 | 54,7 | 57,0 | 59,3 | 61,6 | 63,9 | 66,2 | 68,5 | 70,7 |
| 700 | kg | - | - | - | - | - | - | 40,7 | 43,1 | 45,5 | 48,0 | 50,4 | 52,8 | 55,2 | 57,6 | 60,1 | 62,5 | 64,9 | 67,3 | 69,7 | 72,2 | 74,6 |
| 750 | kg | - | - | - | - | - | 40,2 | 42,8 | 45,3 | 47,8 | 50,4 | 52,9 | 55,5 | 58,0 | 60,5 | 63,1 | 65,6 | 68,2 | 70,7 | 73,2 | 75,8 | 78,3 |
| 800 | kg | - | - | - | - | 39,5 | 42,2 | 44,8 | 47,5 | 50,1 | 52,8 | 55,5 | 58,1 | 60,8 | 63,4 | 66,1 | 68,7 | 71,4 | 74,1 | 76,7 | 79,4 | 82,0 |

Selection graphs

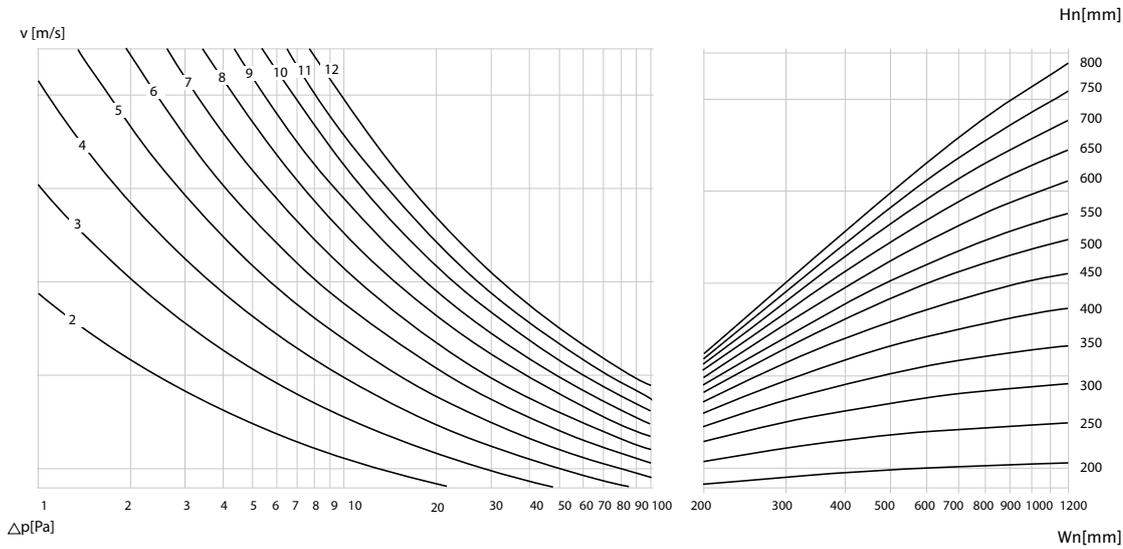

$$\Delta p \text{ [Pa]} = \zeta \cdot v^2 \cdot 0,6$$

| Hn\Wn [mm] | 200 | 250 | 300 | 350 | 400 | 450 | 500 | 550 | 600 | 650 | 700 | 750 | 800 | 850 | 900 | 950 | 1000 | 1050 | 1100 | 1150 | 1200 |
|------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 200 ζ [-] | 8,46 | 7,33 | 6,67 | 6,25 | 5,95 | 5,73 | 5,56 | 5,42 | 5,31 | 5,22 | 5,14 | 5,08 | 5,02 | 4,97 | 4,93 | 4,89 | 4,86 | 4,83 | 4,8 | 4,77 | 4,75 |
| 250 ζ [-] | 4,44 | 3,68 | 3,24 | 2,96 | 2,77 | 2,63 | 2,52 | 2,44 | 2,37 | 2,31 | 2,26 | 2,22 | 2,19 | 2,16 | 2,13 | 2,11 | 2,09 | 2,07 | 2,05 | 2,04 | 2,02 |
| 300 ζ [-] | 2,92 | 2,32 | 1,99 | 1,79 | 1,64 | 1,54 | 1,46 | 1,4 | 1,35 | 1,31 | 1,27 | 1,25 | 1,22 | 1,2 | 1,18 | 1,16 | 1,15 | 1,14 | 1,12 | 1,11 | 1,1 |
| 350 ζ [-] | 2,16 | 1,67 | 1,4 | 1,23 | 1,11 | 1,03 | 0,97 | 0,92 | 0,88 | 0,85 | 0,82 | 0,8 | 0,78 | 0,77 | 0,75 | 0,74 | 0,73 | 0,72 | 0,71 | 0,7 | 0,69 |
| 400 ζ [-] | 1,72 | 1,29 | 1,06 | 0,92 | 0,82 | 0,75 | 0,7 | 0,66 | 0,63 | 0,6 | 0,58 | 0,56 | 0,55 | 0,53 | 0,52 | 0,51 | 0,5 | 0,5 | 0,49 | 0,48 | 0,48 |
| 450 ζ [-] | 1,44 | 1,06 | 0,85 | 0,73 | 0,64 | 0,58 | 0,54 | 0,5 | 0,48 | 0,45 | 0,44 | 0,42 | 0,41 | 0,4 | 0,39 | 0,38 | 0,37 | 0,36 | 0,36 | 0,35 | 0,35 |
| 500 ζ [-] | 1,25 | 0,9 | 0,71 | 0,6 | 0,52 | 0,47 | 0,43 | 0,4 | 0,38 | 0,36 | 0,34 | 0,33 | 0,32 | 0,31 | 0,3 | 0,29 | 0,29 | 0,28 | 0,27 | 0,27 | 0,27 |
| 550 ζ [-] | 1,13 | 0,8 | 0,63 | 0,52 | 0,46 | 0,41 | 0,37 | 0,34 | 0,32 | 0,3 | 0,29 | 0,28 | 0,27 | 0,26 | 0,25 | 0,24 | 0,24 | 0,23 | 0,23 | 0,22 | 0,22 |
| 600 ζ [-] | 1,02 | 0,71 | 0,55 | 0,45 | 0,39 | 0,35 | 0,31 | 0,29 | 0,27 | 0,25 | 0,24 | 0,23 | 0,22 | 0,21 | 0,21 | 0,2 | 0,19 | 0,19 | 0,19 | 0,18 | 0,18 |
| 650 ζ [-] | 0,94 | 0,64 | 0,49 | 0,4 | 0,34 | 0,3 | 0,27 | 0,25 | 0,23 | 0,22 | 0,2 | 0,19 | 0,19 | 0,18 | 0,17 | 0,17 | 0,16 | 0,16 | 0,15 | 0,15 | 0,15 |
| 700 ζ [-] | 0,87 | 0,59 | 0,44 | 0,36 | 0,3 | 0,27 | 0,24 | 0,22 | 0,2 | 0,19 | 0,18 | 0,17 | 0,16 | 0,15 | 0,15 | 0,14 | 0,14 | 0,13 | 0,13 | 0,13 | 0,13 |
| 750 ζ [-] | 0,81 | 0,54 | 0,41 | 0,33 | 0,27 | 0,24 | 0,21 | 0,19 | 0,18 | 0,16 | 0,15 | 0,15 | 0,14 | 0,13 | 0,13 | 0,12 | 0,12 | 0,12 | 0,11 | 0,11 | 0,11 |
| 800 ζ [-] | 0,77 | 0,51 | 0,38 | 0,3 | 0,25 | 0,22 | 0,19 | 0,17 | 0,16 | 0,15 | 0,14 | 0,13 | 0,12 | 0,12 | 0,11 | 0,11 | 0,1 | 0,1 | 0,1 | 0,1 | 0,09 |

Example

Data

Hn = 400 mm, Wn = 500 mm, v = 4 m/s

Required

Δp = ca. 6.8 Pa (Cfr. selection graph)

Calculation

Δp = 0.70 * (4 m/s)² * 0.6 = 6.72 Pa

Selection data


CU2-15 - CU2-15L - Free air passage

| Hn\Wn [mm] | | 200 | 250 | 300 | 350 | 400 | 450 | 500 | 550 | 600 | 650 | 700 |
|------------|----------------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| 200 | Sn [m ²] | 0,0128 | 0,0173 | 0,0217 | 0,0262 | 0,0306 | 0,0351 | 0,0395 | 0,0440 | 0,0484 | 0,0529 | 0,0573 |
| | Sn [%] | 34,05 | 36,48 | 38,07 | 39,21 | 40,05 | 40,71 | 41,23 | 41,66 | 42,01 | 42,31 | 42,57 |
| 250 | Sn [m ²] | 0,0200 | 0,0270 | 0,0339 | 0,0409 | 0,0478 | 0,0548 | 0,0617 | 0,0687 | 0,0756 | 0,0826 | 0,0895 |
| | Sn [%] | 42,28 | 45,29 | 47,28 | 48,69 | 49,74 | 50,55 | 51,20 | 51,73 | 52,17 | 52,54 | 52,86 |
| 300 | Sn [m ²] | 0,0272 | 0,0367 | 0,0461 | 0,0556 | 0,0650 | 0,0745 | 0,0839 | 0,0934 | 0,1028 | 0,1123 | 0,1217 |
| | Sn [%] | 47,72 | 51,11 | 53,35 | 54,94 | 56,13 | 57,05 | 57,78 | 58,38 | 58,87 | 59,29 | 59,65 |
| 350 | Sn [m ²] | 0,0344 | 0,0464 | 0,0583 | 0,0703 | 0,0822 | 0,0942 | 0,1061 | 0,1181 | 0,1300 | 0,1420 | 0,1539 |
| | Sn [%] | 51,57 | 55,24 | 57,66 | 59,38 | 60,66 | 61,65 | 62,44 | 63,09 | 63,63 | 64,08 | 64,47 |
| 400 | Sn [m ²] | 0,0416 | 0,0561 | 0,0705 | 0,0850 | 0,0994 | 0,1139 | 0,1283 | 0,1428 | 0,1572 | 0,1717 | 0,1861 |
| | Sn [%] | 54,45 | 58,32 | 60,88 | 62,69 | 64,04 | 65,09 | 65,93 | 66,61 | 67,18 | 67,66 | 68,07 |
| 450 | Sn [m ²] | 0,0488 | 0,0658 | 0,0827 | 0,0997 | 0,1166 | 0,1336 | 0,1505 | 0,1675 | 0,1844 | 0,2014 | 0,2183 |
| | Sn [%] | 56,67 | 60,71 | 63,37 | 65,25 | 66,66 | 67,75 | 68,62 | 69,33 | 69,92 | 70,42 | 70,85 |
| 500 | Sn [m ²] | 0,0546 | 0,0735 | 0,0925 | 0,1114 | 0,1304 | 0,1493 | 0,1683 | 0,1872 | 0,2062 | 0,2251 | 0,2441 |
| | Sn [%] | 56,95 | 61,00 | 63,67 | 65,57 | 66,98 | 68,08 | 68,96 | 69,67 | 70,26 | 70,76 | 71,19 |
| 550 | Sn [m ²] | 0,0618 | 0,0832 | 0,1047 | 0,1261 | 0,1476 | 0,1690 | 0,1905 | 0,2119 | 0,2334 | 0,2548 | 0,2763 |
| | Sn [%] | 58,54 | 62,70 | 65,45 | 67,40 | 68,85 | 69,98 | 70,88 | 71,61 | 72,22 | 72,74 | 73,18 |
| 600 | Sn [m ²] | 0,0690 | 0,0929 | 0,1169 | 0,1408 | 0,1648 | 0,1887 | 0,2127 | 0,2366 | 0,2606 | 0,2845 | 0,3085 |
| | Sn [%] | 59,86 | 64,12 | 66,93 | 68,92 | 70,41 | 71,56 | 72,48 | 73,23 | 73,85 | 74,38 | 74,83 |
| 650 | Sn [m ²] | 0,0762 | 0,1026 | 0,1291 | 0,1555 | 0,1820 | 0,2084 | 0,2349 | 0,2613 | 0,2878 | 0,3142 | 0,3407 |
| | Sn [%] | 60,97 | 65,31 | 68,17 | 70,20 | 71,72 | 72,89 | 73,83 | 74,59 | 75,23 | 75,77 | 76,22 |
| 700 | Sn [m ²] | 0,0834 | 0,1123 | 0,1413 | 0,1702 | 0,1992 | 0,2281 | 0,2571 | 0,2860 | 0,3150 | 0,3439 | 0,3729 |
| | Sn [%] | 61,93 | 66,33 | 69,24 | 71,30 | 72,84 | 74,03 | 74,99 | 75,76 | 76,41 | 76,95 | 77,42 |
| 750 | Sn [m ²] | 0,0906 | 0,1220 | 0,1535 | 0,1849 | 0,2164 | 0,2478 | 0,2793 | 0,3107 | 0,3422 | 0,3736 | 0,4051 |
| | Sn [%] | 62,75 | 67,22 | 70,16 | 72,25 | 73,81 | 75,02 | 75,99 | 76,77 | 77,43 | 77,98 | 78,45 |
| 800 | Sn [m ²] | 0,0978 | 0,1317 | 0,1657 | 0,1996 | 0,2336 | 0,2675 | 0,3015 | 0,3354 | 0,3694 | 0,4033 | 0,4373 |
| | Sn [%] | 63,48 | 67,99 | 70,97 | 73,09 | 74,66 | 75,89 | 76,86 | 77,66 | 78,32 | 78,88 | 79,36 |

| Hn\Wn [mm] | | 750 | 800 | 850 | 900 | 950 | 1000 | 1050 | 1100 | 1150 | 1200 |
|------------|----------------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| 200 | Sn [m ²] | 0,0618 | 0,0662 | 0,0707 | 0,0751 | 0,0796 | 0,0840 | 0,0885 | 0,0929 | 0,0974 | 0,1018 |
| | Sn [%] | 42,79 | 42,99 | 43,16 | 43,31 | 43,45 | 43,57 | 43,68 | 43,78 | 43,87 | 43,96 |
| 250 | Sn [m ²] | 0,0965 | 0,1034 | 0,1104 | 0,1173 | 0,1243 | 0,1312 | 0,1382 | 0,1451 | 0,1521 | 0,1590 |
| | Sn [%] | 53,14 | 53,38 | 53,59 | 53,78 | 53,95 | 54,10 | 54,24 | 54,36 | 54,48 | 54,58 |
| 300 | Sn [m ²] | 0,1312 | 0,1406 | 0,1501 | 0,1595 | 0,1690 | 0,1784 | 0,1879 | 0,1973 | 0,2068 | 0,2162 |
| | Sn [%] | 59,97 | 60,24 | 60,48 | 60,69 | 60,88 | 61,05 | 61,21 | 61,35 | 61,48 | 61,59 |
| 350 | Sn [m ²] | 0,1659 | 0,1778 | 0,1898 | 0,2017 | 0,2137 | 0,2256 | 0,2376 | 0,2495 | 0,2615 | 0,2734 |
| | Sn [%] | 64,81 | 65,10 | 65,36 | 65,59 | 65,80 | 65,98 | 66,15 | 66,30 | 66,44 | 66,57 |
| 400 | Sn [m ²] | 0,2006 | 0,2150 | 0,2295 | 0,2439 | 0,2584 | 0,2728 | 0,2873 | 0,3017 | 0,3162 | 0,3306 |
| | Sn [%] | 68,42 | 68,73 | 69,00 | 69,25 | 69,47 | 69,66 | 69,84 | 70,00 | 70,14 | 70,28 |
| 450 | Sn [m ²] | 0,2353 | 0,2522 | 0,2692 | 0,2861 | 0,3031 | 0,3200 | 0,3370 | 0,3539 | 0,3709 | 0,3878 |
| | Sn [%] | 71,22 | 71,54 | 71,83 | 72,08 | 72,31 | 72,51 | 72,69 | 72,86 | 73,01 | 73,15 |
| 500 | Sn [m ²] | 0,2630 | 0,2820 | 0,3009 | 0,3199 | 0,3388 | 0,3578 | 0,3767 | 0,3957 | 0,4146 | 0,4336 |
| | Sn [%] | 71,56 | 71,89 | 72,18 | 72,43 | 72,66 | 72,86 | 73,05 | 73,21 | 73,37 | 73,51 |

| Hn\Wn (mm) | | 750 | 800 | 850 | 900 | 950 | 1000 | 1050 | 1100 | 1150 | 1200 | |
|------------|----------------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--|
| 550 | Sn [m ²] | 0,2977 | 0,3192 | 0,3406 | 0,3621 | 0,3835 | 0,4050 | 0,4264 | 0,4479 | 0,4693 | 0,4908 | |
| | Sn [%] | 73,56 | 73,89 | 74,19 | 74,45 | 74,68 | 74,89 | 75,08 | 75,26 | 75,41 | 75,56 | |
| 600 | Sn [m ²] | 0,3324 | 0,3564 | 0,3803 | 0,4043 | 0,4282 | 0,4522 | 0,4761 | 0,5001 | 0,5240 | 0,5480 | |
| | Sn [%] | 75,22 | 75,56 | 75,86 | 76,13 | 76,37 | 76,58 | 76,78 | 76,95 | 77,12 | 77,26 | |
| 650 | Sn [m ²] | 0,3671 | 0,3936 | 0,4200 | 0,4465 | 0,4729 | 0,4994 | 0,5258 | 0,5523 | 0,5787 | 0,6052 | |
| | Sn [%] | 76,62 | 76,97 | 77,28 | 77,55 | 77,79 | 78,01 | 78,21 | 78,39 | 78,55 | 78,70 | |
| 700 | Sn [m ²] | 0,4018 | 0,4308 | 0,4597 | 0,4887 | 0,5176 | 0,5466 | 0,5755 | 0,6045 | 0,6334 | 0,6624 | |
| | Sn [%] | 77,82 | 78,18 | 78,49 | 78,76 | 79,01 | 79,23 | 79,43 | 79,62 | 79,78 | 79,94 | |
| 750 | Sn [m ²] | 0,4365 | 0,4680 | 0,4994 | 0,5309 | 0,5623 | 0,5938 | 0,6252 | 0,6567 | 0,6881 | 0,7196 | |
| | Sn [%] | 78,86 | 79,22 | 79,53 | 79,81 | 80,07 | 80,29 | 80,49 | 80,68 | 80,85 | 81,00 | |
| 800 | Sn [m ²] | 0,4712 | 0,5052 | 0,5391 | 0,5731 | 0,6070 | 0,6410 | 0,6749 | 0,7089 | 0,7428 | 0,7768 | |
| | Sn [%] | 79,77 | 80,13 | 80,45 | 80,73 | 80,99 | 81,21 | 81,42 | 81,61 | 81,78 | 81,94 | |

Sample order



1. product
2. width
3. height
4. frame on the side of the mechanism
5. frame on the side of the wall
6. mechanism type
7. option: uni/bipolar switches

Approvals and certificates

All our dampers are submitted to a number of tests by official test institutes. Reports of these tests form the basis for the approvals of our dampers.



BCCA-0749-CPR-BC1-606-0464-15650.04-0464; BCCA-0749-CPR-BC1-606-0464-15650.14-0464



18.13

The NF-label guarantees: conformity with the standard NF S 61-937 Parts 1 and 5: "Systèmes de Sécurité Incendie Dispositifs Actionnés de Sécurité"; conformity with the national decree of March 22, 2004, changed on 14 March 2011 for the classification of fire resistance; the values of the characteristics mentioned in this document. Organisme Certificateur: AFNOR Certification, 11 Rue Francis de Pressensé, F93571 La Plaine Saint-Denis Cedex; Website: <http://www.afnor.org> <http://www.marque-nf.com>; Phone: +33 (0)1.41.62.80.00, Fax: +33 (0)1.49.17.90.00, Email: certification@afnor.org

If the product is manipulated in any other way than described in this manual, Rf-Technologies will decline any responsibility and the guarantee will expire!